

*Innovative **Global** Solutions
for Low Pressure Systems Protection*

Represented by:

LE Linden Equipment Co.

1185 Tower Road
Schaumburg, IL 60173
Ph. 847.885.0300 Fax: 847.885.0303
lindenequipment.com

- Pressure/Vacuum Relief Valves
- Pressure Relief Valves
- Vacuum Relief Valves
- Pilot Operated Relief Valves
- Emergency Relief Valves
- Flame & Detonation Arresters
- Blanket Gas Regulators

OVERVIEW

GROTH CORPORATION

Groth Corporation was established as Groth Equipment Corporation in Houston, Texas in 1960. In 1971 Groth began manufacturing pressure/vacuum relief valves and flame arresters. Today, Groth is a global leader in manufacturing pressure/vacuum relief valves, flame and detonation arresters, blanket gas regulators and other low pressure relief products. We are located in Stafford, Texas, in a new facility. In September 1999, Groth became a part of the Continental Disc Corporation family of companies that produce pressure relief products for industrial applications. Continental Disc Corporation is headquartered in Liberty, Missouri.

PRESSURE/VACUUM RELIEF VALVE

The pressure/vacuum relief valve is a protection device mounted on a nozzle opening on the top of a fixed roof atmospheric storage tank. Its primary purpose is to protect the tank against rupturing or imploding. Without an opening or a controlled opening, a fixed roof atmospheric tank would rupture under increasing pressure caused by pumping liquid into the tank or as a result of vapor pressure changes caused by severe thermal changes. Imploding, or the collapsing of a tank, occurs during the pumping out procedure or thermal changes. As the liquid level lowers, the vapor space pressure is reduced to below atmospheric pressure. This vacuum condition must be controlled by allowing atmospheric air to flow

into the tank. In short, the tank needs to breathe in order to eliminate the possibility of rupturing or imploding. Because of its primary function, a pressure/vacuum valve is commonly referred to as a “breather valve.”

FLAME/DETONATION ARRESTERS

Flame arresters are fire safety devices. They prevent flames from entering a tank and also provide protection from flashes within a tank. They can also be used as an in-line flashback prevention device.

EMERGENCY VALVE

The primary function of the emergency relief valve is to provide a controlled opening on a tank that will be large enough to prevent rupturing of the tank under severe pressure increases caused by proximity to intense fire.

Each of these safety devices are used on the atmospheric, fixed roof, non-refrigerated storage tank.



PRESSURE VACUUM RELIEF VALVES



FLAME AND DETONATION ARRESTERS

BLANKET GAS REGULATOR & PILOT OPERATED RELIEF VALVE

Pressure/Vacuum Relief Valves

WHY PRESSURE/VACUUM RELIEF VALVES ARE REQUIRED

1. Saves money by saving product.
2. Protects tank from over or under pressure when sized properly.
3. Protection against fire hazard when conforming to API standards.
4. Minimizes evaporation loss.
5. Reduces atmospheric corrosion of tank.
6. Generally in all cases required by OSHA, EPA, etc.

PRESSURE/VACUUM VALVES SAVE MONEY

Actually, any properly sized opening in the tank's upper structure protects the tank from damage, but utilizing a pressure and vacuum valve also serves to accomplish other advantages. Two of the more important are: economic savings and fire hazard protection. In 1952, American Petroleum Institute developed a formula to determine tank evaporative losses. The API equation was formulated after the results of a total of 256 individual tests were compiled. Of the 256 tanks tested (1/2 with open vents and 1/2 with pressure/vacuum valves), only 178 were considered valid. The remainder were eliminated because of inadequate data, obviously incorrect test methods, poor tank conditions, or leaky fittings. The API has a formula for calculating tank breathing loss. The principle factors are: turnovers per year, true vapor pressure of the product, diameter of the tank in feet, the average outage in feet, the average daily ambient temperature change, and the paint factor. The test was conducted on tanks containing gasoline with pressure and vacuum valves set at

1/2 oz. pressure and 1/2 oz. vacuum. API 2521 states that 1/2 oz. is the usual setting.

CALCULATING TANK PRODUCT LOSS

A multiple correlation for tanks 20 feet in diameter or larger, based on model equation, derived from the tests on the tanks, yielded in the case of gasoline:

$$L_y = \frac{TPY}{1,000} \left(\frac{P}{14.7-P} \right)^{.68} D^{1.73} H^{.51} T^{.50} F_p$$

Where:

- L_y = the breathing loss in barrels per year.
- TPY = turn overs per year
- P = the true vapor pressure at bulk liquid temperature in pounds per square inch absolute
- D = tank diameter in feet
- H = the average outage in feet
- T = average daily ambient temperature change
- F_p = the paint factor

A modification of the above equation was then required which would accommodate small-diameter tanks.

$$L_y = \frac{TPY}{1,000} \left(\frac{P}{14.7-P} \right)^{.68} D^{1.73} H^{.51} T^{.50} F_p C$$

Where:

- C = adjustment factor for smaller diameter tanks

IN MOST CASES A PRESSURE/VACUUM RELIEF VALVE WILL PAY FOR ITSELF BEFORE YOU PAY THE INVOICE

The results of these tests indicate that the evaporation loss on a tank with a 55,000 barrel capacity would be 2,000 barrels per year if an open vent was installed, and only 1,382 barrels per year if a pressure/vacuum valve was utilized, thereby saving 618 barrels per year, every year. This study also coined a new catchword, "Conservation Vent." So if you hear the term conservation vent, you know that the valve referred to is a pressure/vacuum valve or breather valve.

If the product in the tank cost \$40 per barrel, this would be a savings in one year of \$24,720 per tank. Pressure/vacuum relief valves provide savings of millions of dollars and millions of barrels of product in a large facility such as the one illustrated on page 4. Depending on size and materials of construction, a breather valve can pay for itself in less than a month.

API'S ESTIMATED BREATHING LOSS TABLE

Tank Diameter in feet	Nominal Tank Capacity	Breathing loss		BBLs/Year Saved Using Pressure Relief Valve
		Estimated Losses With Pressure Relief Valve	Estimated Losses with Open Vent	
30	5,000	154	235	81
42.5	10,000	297	441	144
60	20,000	570	825	255
100	55,000	1,382	2,000	618

Pressure/Vacuum Relief Valves

BASIC FIRE PROTECTION

An advantage of using a pressure/vacuum valve is that the valve provides fire protection for the tank. A pressure/vacuum valve is normally closed except when venting due to pressure or vacuum conditions. An open vent always has a free passageway between the vapor in the tank and atmosphere. Therefore, a pressure/vacuum valve is usually closed allowing the tank vapor to reach true vapor pressure.

Under true vapor pressure, the vapor in the tank is too rich to burn. The tank is also closed off eliminating a free passageway for fire or sparks to ignite the potentially combustible vapor in the tank. If the valve has been activated by excessive tank pressure, the now open valve is causing a condition where any vapors escaping are under positive pressure and the fire hazard will be kept away from the vapor content of the tank. If flames are in the area and the tank is being emptied, vapors are not escaping and combustion is not likely to occur even though the tank may have a combustible mixture.

1. Closed tank principle. When a pressure/vacuum valve is closed, vapors are not escaping to support combustion.
2. Pressure when open principle. When the valve is open, the velocity of the relieving vapor is greater than the flame speed.
3. Over rich principle due to equilibrium being reached in a closed tank and therefore the vapors are too rich to burn. When emptying or pumping from the tank, oxygen rich vapors are susceptible to burning and flame arresters should be installed between the pressure/vacuum relief valve and tank nozzle.
4. The vacuum created during pump out of product will prevent fumes from escaping which normally does not present a fire hazard.

REDUCED CORROSION

An additional reason for using pressure/vacuum valves, they help reduce overall corrosion in the plant. Plant corrosion is reduced due to less product escaping from the tank and therefore less corrosion is produced by escaping vapors. This means overall plant maintenance is reduced thereby saving labor and dollars.

RECOMMENDED AND REQUIRED

Pressure/vacuum valves are recommended by API 2000 for use on atmospheric storage tanks in which oil with a flash point below 100° F is stored. OSHA states that tanks storing Class 1 liquids shall be equipped with venting devices which shall be normally closed except under pressure or vacuum condition.


Generally speaking, the majority of the regulatory bodies dealing with tank safety, API, OSHA, NFPA, Insurance Companies etc. require installation of these devices on flammable liquid storage tanks.



Pressure/Vacuum Valve Operation

HOW PRESSURE/VACUUM RELIEF VALVES OPERATE

How does a pressure/vacuum valve operate? Most atmospheric tanks require a venting device that will allow large volumes of vapor to escape under relatively low pressures. Usually the allowable set pressure is in inches of water column pressure, both for positive and vacuum conditions. This is because most large storage tanks have a relatively low maximum allowable working pressure. These tanks are generally large volume welded vessels that are built to API 650 standard. In order to accommodate large volumes at low set pressures, these valves have ports that are greater in area than the inlet or nozzle connection. The low setting required necessitates weight loading the valve as opposed to spring loading. Because of the above, a pressure/vacuum valve requires approximately 100% over set pressure in order to reach full opening of the valve. However, when deciding on a set pressure, the weight-loaded valve operation MAWP should be at least twice the required set pressure

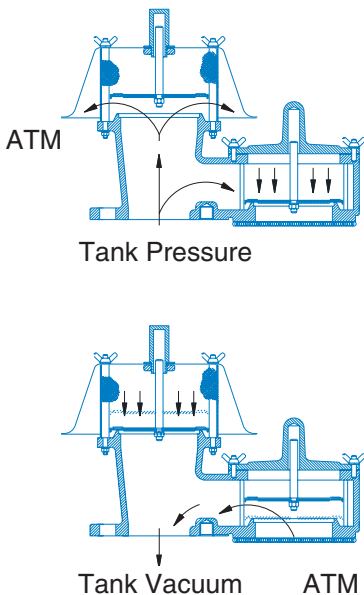

to obtain optimum flow. If the MAWP is less than 100% above the required set, the valve could be larger in size than normally required. The possibility of valve chatter and accelerated seat and diaphragm wear will exist if less than 20% over pressure is allowed. Simply stated, a pressure/vacuum valve is not


exactly like a high pressure safety relief valve and should not be sized at 10% or 20% over pressure. When sizing a pressure/vacuum valve, consult the manufacturer flow tables and allow sufficient overset pressure.

SPRING LOADED VALVES

The spring loaded valve is used on higher pressure tanks (1-15 PSIG settings). They will protect from over pressure and excessive vacuum while reducing tank breathing, thereby saving product.

Spring loaded valves weigh less than a weight loaded valve set at 1 psi.

MODEL 1201B

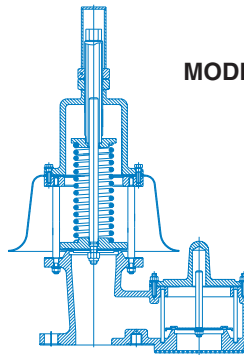


PILOT OPERATED RELIEF VALVE

The Pilot Operated Relief Valve is designed to provide safe, dependable, and accurate low pressure and/or vacuum protection. Full flow is attained at no more than 10% overpressure. This reduces the need for high over pressure which conserves product and reduces fugitive emissions. Blowdown may be adjusted to requirements between 0% and 20% of set pressure. Properly adjusted the Pilot Operated Relief Valve is bubble tight up to 95% of set pressure. The Pilot Operated Relief Valve provides the maximum available control technology as specified in the Clean Air Act of 1990.



MODEL 1660A

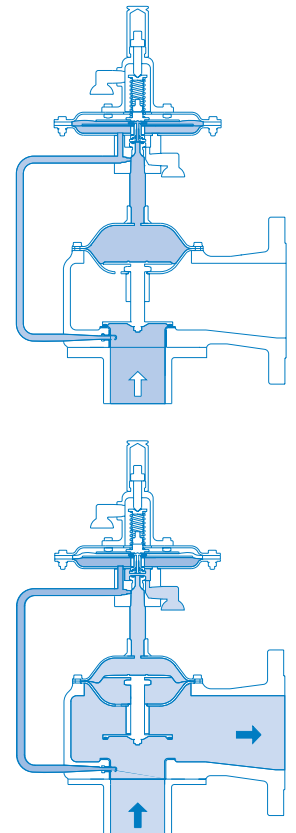

API Standard 2000 for Venting Atmospheric and Low Pressure Storage Tanks

SIZING A PRESSURE/VACUUM RELIEF VALVE

API Standards are provided as an engineering aid for specification and selection of “normal” and “emergency” pressure and vacuum relief valves for aboveground liquid petroleum storage tanks. Normal venting capacity is obtained without exceeding pressure or vacuum that would cause physical damage or permanent deformation to the tank. The following will help in sizing a pressure/vacuum valve:

1. Normal Relief: The sum of vapor replacement resulting from emptying or filling and thermal in-breathing or out-breathing.
2. Emergency Relief: Thermal out-breathing from fire exposure.
3. All Tanks: Generally require the sizing of a normal pressure and vacuum relief valve to be sized and an independent emergency relief valve to be sized separately.
4. Flow Curves: These curves provide pressure and vacuum capacity which is required for sizing.

OSHA AND API REQUIREMENTS

The OSHA requirement for tank protection published by the Department of Labor as part 1910.106, revised July 1, 1985, addresses sizing requirements. OSHA suggests sizing shall be in accordance with API 2000, which clearly defines all requirements.

PRESSURE/VACUUM RELIEF VALVE SETTING


API 2521

“Pressure/vacuum valves on atmospheric pressure fixed-roof tanks are usually set at 1/2 oz. per square inch pressure or vacuum. Test data indicate that an increase of 1 oz. per square inch in the pressure set point over the usual 1/2 oz. per square inch reduces breathing losses by approximately 7 percent. However, the test data indicate that each additional increase of 1 oz. per square inch in pressure set point reduces the breathing losses in progressively smaller increments.”

API 2513


“The pressure and vacuum setting of a breather valve are dictated by the structural characteristics of the tank and should be within safe operating limits. A certain amount of pressure and vacuum beyond this setting is necessary to overcome pressure drop in order to obtain required flow. Proper size and settings can best be determined by reference to API Std 2000: Venting Atmospheric and Low-Pressure Storage Tanks (1992) and to the manufacturer's tank data determined in accordance with this publication. The pressure setting for pressure/vacuum valves to be installed on large tanks constructed in accordance with API 12: Specification for Large Welded Production Tanks (1957) usually is limited to 1/2 oz. because roof plates will start to shift when the pressure increases above 1 oz.”

STORAGE TANK DESIGN (National Fire Protection Agency)

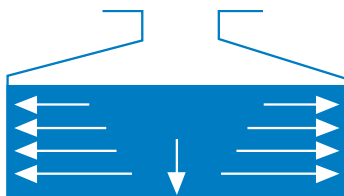


1. TO HOLD LIQUID

Liquid exerts pressure on the sides and base of the tank. Pressure=height of liquid.

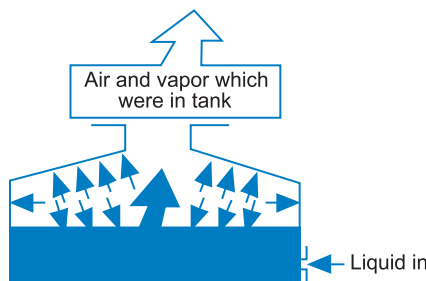

2. TO BE FILLED

For liquid to get in, air and vapor must get out. If they can't, the tank will be pressurized. For air and vapor to be pushed out, the pressure in the tank must be slightly above atmospheric pressure. The tank is designed for an internal pressure of 8 in. water gage (WG).

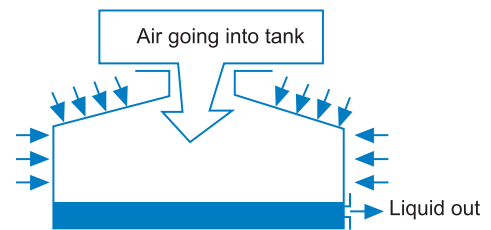


3. TO BE EMPTIED

For liquid to get out, air must get in. If it can't, the tank will be underpressured. For air to be sucked in, the pressure in the tank must be slightly below atmospheric pressure. The tank is designed for an external pressure (or vacuum in the tank) of 2 1/2 in. WG.

FLAME ARRESTER

A flame arrester is a safety device installed on a nozzle on top of a tank when the flash point of the stored product is lower than the possible tank temperature. A majority of the time, a “vent to atmosphere” pressure/vacuum valve is installed on top of the flame arrester. A flame arrester is also used as in-line safety device where combustible

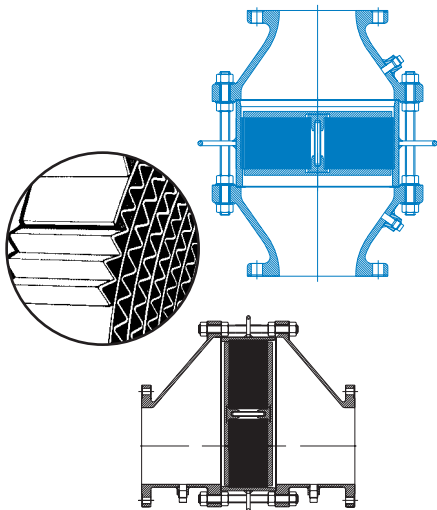

gases are transported through low pressure pipe lines to actual combustion, as in an incinerator or flare or where combustion fumes are vented through piping to atmosphere where lightning can cause a flame. Flame arresters should be designed to stop tank farm fires caused by lightning, sparking, or actual flame in the immediate tank area, and to prevent flashbacks in lines. In order to accomplish the above, a flame arrester must act as a barrier (stop a flame), a flame holder (contain the flame at the barrier), and dissipate heat in order to prevent auto ignition on the down side of the flame arrester.

In order to be an effective flame prevention device, a flame arrester must have a quenching or hydraulic diameter small enough to stop the flame created by the combustible gas. Each combustible gas has a different required hydraulic diameter to stop the flame.

In addition to stopping the flame, an arrester must be able to dissipate heat. Flame element mass ensures that hot gases above the auto ignition temperature never reach the downstream side of the flame arrester.

With an in-line installation, structural integrity is important to insure safety if a detonation should occur. Proper gasketing to insure an oxygen-free environment in the event of a detonation is also important. Unless a flame arrester meets or exceeds the above mentioned design criteria, it is not a true flame arrester.

DETONATION ARRESTER

A detonation arrester is another safety device installed in a piping system. A detonation is defined as a flame front propagating through a flammable gas or vapor at a velocity equal to or greater than the speed of sound. A detonation arrester should be installed when the source of a flash back is greater than ten pipe diameters from the installation of the arrester or when there is a possible restriction in the line. Groth Detonation Flame Arresters are bi-directional and can be installed in a vertical or horizontal piping installation. The model 7658A has been successfully tested and USCG approved as a Type II Detonation Flame Arrester suitable for applications where stationary flames may rest on the element.

AIR OPERATED RELIEF VALVE

Air operated relief valves are used to replace weight loaded and pilot operated valves in severe applications where polymerization and crystallization may take place and plug as well as corrode the pilot valve. The pressure switch coupled with a solenoid valve and using plant instrument air instead of corrosive product vapor provides a bubble tight seal in the valve.



MODEL 1520



MODEL 7658A

PRODUCT DETAIL

EMERGENCY VALVES

Emergency valves are required by API on storage tanks in order to protect the tank against excessive pressure caused by external fire exposure or flashes within the tank. The excessive pressure caused by an external fire is generally because an adjacent tank is on fire or some other structure in proximity is on fire. Flashes are generally caused by a chemical reaction in the tank. Regardless of the cause of the excessive pressure, an opening larger than the normal pressure/vacuum valve is necessary in

order to carry off the additional volume resulting from the fire exposure the tank is experiencing. API 2000 states emergency venting may be accomplished by the use of:

1. Larger or additional open vents
2. Larger or additional pressure/vacuum valves or pressure relief valves
3. A gage hatch which permits the cover to lift under abnormal internal pressure
4. A manhole cover which permits the cover to lift under abnormal internal pressure (ERV Model 2000A/2400A)

5. A connection between the roof and shell which is weaker than the weakest vertical joint in the shell or shell to bottom connection (weak roof to shell weld)


MODEL 2000A



VAPOR RECOVERY SYSTEM

With the implementation of the Clean Air Act of 1990, most Liquid Product Storage terminals and hydrocarbon processing plants must control evaporative hydrocarbon emissions from loading and storage operations. Two types of recognized technologies are vapor recovery using carbon absorption or vapor combustion. Both systems require pressure/vacuum valves and flame or detonation arresters to minimize emissions and maximize safety.


TYPICAL VAPOR RECOVERY SYSTEM

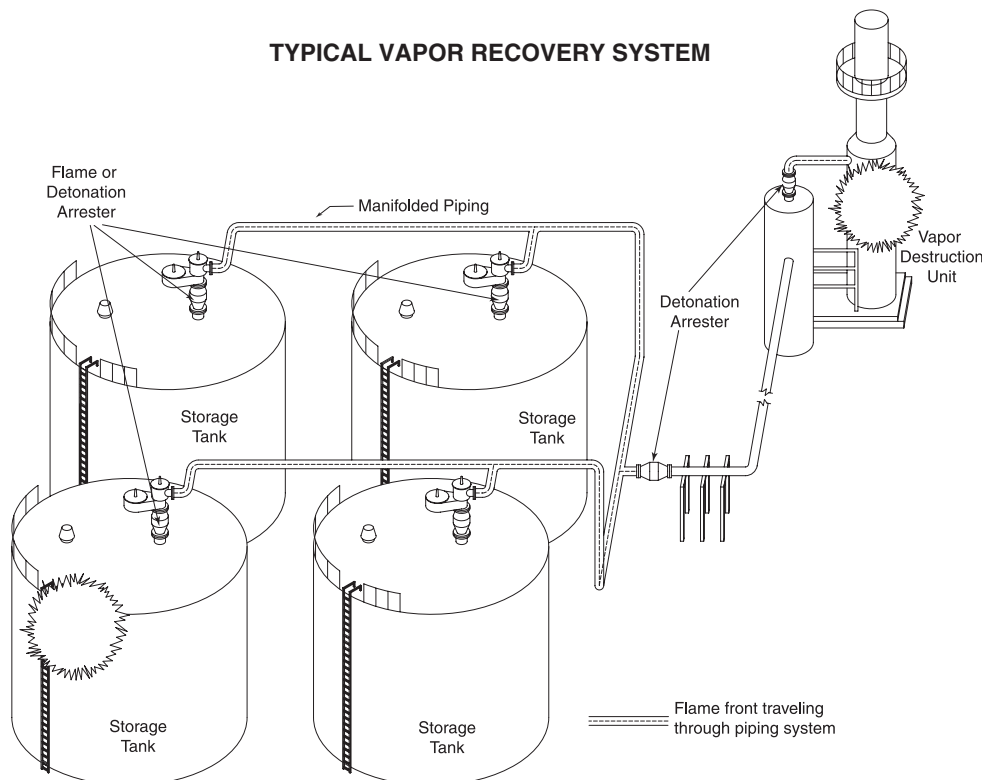

VAPOR EMISSION REDUCTION

GAS BLANKETING


The Groth Blanket Gas Regulator ensures that a constant gas pressure is maintained in the vapor space of a storage tank. When liquid is removed from a tank or the temperature is reduced, a vacuum would be developed. With the Groth

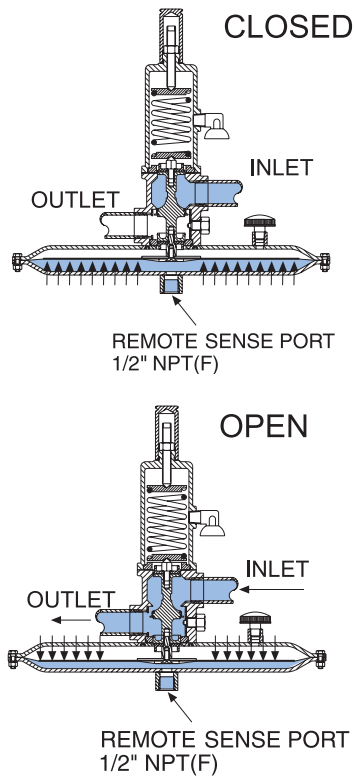

Blanket Gas Regulator, a blanket gas is supplied to prevent a vacuum from developing and to maintain the desired blanket pressure. In addition to preventing outside air and moisture from entering the storage vessel, a blanket gas pressure, as low as 1/2" W.C., reduces the evaporation of the stored product to a negligible amount. The result not only conserves product but also greatly reduces emissions. These advantages are in addition to the fire protection that is provided.

CLEAN AIR ACT OF 1990 METHOD 21 LEAK TEST

The 1990 amendment to the 1977 Clean Air Act requires the emissions of any of the identified volatile organic compounds (VOCs) be kept to under 500 parts per million (PPM). Method 21 is the leak test procedure used to detect rate of leakage from process equipment, including valves, flanges, pressure relief devices, etc. Groth Corporation Pilot Operated Valves (with the film seat option) and Blanket Gas Regulators provide pressure and/or vacuum protection for liquid storage tanks while assuring your compliance with the Clean Air Act.

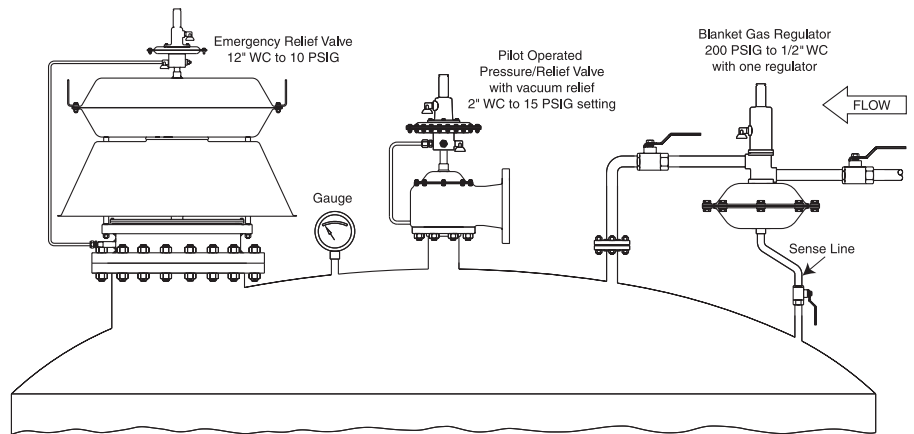

CONCLUSION

Tank protection equipment is specialized. Understanding this equipment and how it should be applied will ensure that your storage tank is protected properly from any number of potential hazards. Protection from rupturing or imploding and protection from fire hazards are the major considerations. Environmental and conservation features enhance the value of these products.

CAL-Q-SIZE PRODUCT CAPACITY RATINGS

PC compatible sizing program for Pressure/Vacuum Valves in accordance with API 2000. Download from our website at www.grothcorp.com or contact Groth Corporation Sales Department.

PRESSURE/VACUUM RELIEF VALVES



Model 1200 A

- Pressure/Vacuum Relief Valve
- Modular design
- Sizes: 2" through 12"
- Pressure settings: 1/2 oz./in.² to 15 PSIG
- Vacuum settings: 1/2 oz./in.² to 12 PSIG



Model 1220 A

- Pressure/Vacuum Relief Valve
- Pipe-away feature
- Modular design
- Sizes: 2" through 12"
- Pressure settings: 1/2 oz./in.² to 15 PSIG
- Vacuum settings: 1/2 oz./in.² to 12 PSIG



Model 1220 A / 7618

- Pressure/Vacuum Relief Valve and Flame Arrester w/Pipe-Away Feature



Fiberglass Valves

- Most Groth valves can be constructed of fiberglass.

PRESSURE RELIEF VALVES



Model 1260 A

- Pressure Relief Valve
- Modular design
- Pipe-away feature
- Sizes: 2" through 12"
- Pressure settings: 1/2 oz./in.² to 15 PSIG



Model 2300 .A

- Pressure Relief Valve
- Modular design
- Sizes: 2" through 12"
- Pressure settings: 1/2 oz./in.² to 15 PSIG



Model 1300 A

- Vacuum breaker
- Modular design
- Sizes: 2" through 12"
- Vacuum settings: 1/2 oz./in.² to 12 PSIG



Model 1360 A

- Vacuum breaker
- Modular design
- Side mount
- Modular design
- Sizes: 3" through 14"
- Vacuum settings: 1/2 oz./in.² to 12 PSIG

PILOT OPERATED RELIEF VALVES



Model 1660A

- Pressure Relief Valve
- High flow capacity
- Sizes: 2" through 12"
- Pressure settings: 2" W.C. through 15 PSIG



Model 1420

- Pressure/Vacuum Relief Valve
- Modular design
- Pressure & vacuum relief
- High flow capacity
- Sizes: 2" through 12"
- Pressure settings: 3 oz./in.² through 15 PSIG
- Vacuum settings: 1/2 oz./in.² to 12 PSIG



Model 1560

- Air actuated pressure relief for extreme service
- Modular design
- Pressure relief
- High flow capacity
- Sizes: 2" through 12"
- Pressure settings: 3 oz./in.² through 15 PSIG



Model 2500

- Emergency Relief Valve
- Sizes: 18" and 24"
- Pressure settings: 8 oz./in.² to 15 PSIG

Available in aluminum (type 356), carbon steel, stainless steel, fiberglass, and other materials, in most models.

EMERGENCY RELIEF VALVES



Model 2301A

- Pressure Relief Valve
- Sizes: 2" through 12"
- Pressure settings: 1/2 oz./in.² to 15 PSIG



Model 2000A

- Emergency Relief Manhole Cover
- Sizes: 16", 20", and 24"
- Pressure settings: 1-1/2 oz./in.² to 16 oz./in.²
- Also available with vacuum breaker



Model 2450A

- Emergency Relief Manhole Cover with hinged cover with vacuum breaker
- Sizes: 20" through 24"
- Vacuum settings: 1/2 oz./in.² to 4 oz./in.²
- Pressure settings: 2 oz./in.² to 8 oz./in.²
- Also available pressure only



Model 2100


- High Pressure Emergency Relief Valve
- Sizes: 16", 20", and 24"
- Pressure settings: 1 PSIG to 15 PSIG

FLAME AND DETONATION ARRESTERS



Model 7618

- Flame arrester (vertical design)
- FM approved
- Sizes: 2" through 60"
- Available with weather hood

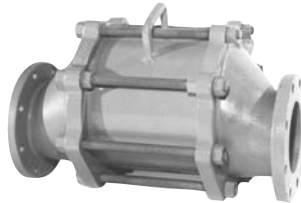

Model 7628

- Flame arrester (horizontal design)
- FM approved
- Sizes: 2" through 30"



Model 7658 A

- Detonation arrester (horizontal design)
- Coast Guard approved
- Sizes: 2" through 24"



Model 7622

- Flame check
- Sizes: 1/2" through 1-1/2"


BLANKET GAS REGULATOR



Series 3000


- Blanket Gas Regulators
- Depad Valves
- Setting from 0.5" W.C. to 15 PSIG
- Consult factory for vacuum applications

FLAME TRAP ASSEMBLIES

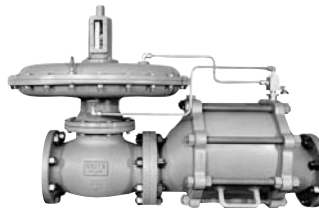

Model 8400A


- Back Pressure Regulator and Flame Trap Assembly
- Sizes: 2" through 12"

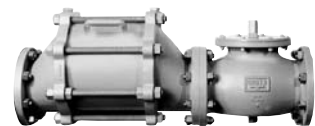

Model 8500A

- Flame Trap Assembly
- Sizes: 2" through 12"

STEAM JACKETED PRODUCTS

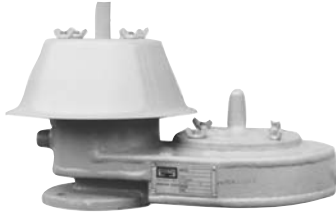

Most Groth valves and flame arresters can be steam jacketed.

ADDITIONAL PRODUCTS



Model 6000 Series

- Gauge hatch
- Sizes: 4" through 10"



Model 8110

- Back Pressure Check Valve
- Sizes 2" through 12"

TEST STANDS



Pressure/Vacuum Relief Valve Test Stand

- Provides convenient, accurate testing and setting of P/V valves or high pressure relief valves. Includes leak testing.

Groth is committed to the total quality improvement process.

Visit us at our website:
www.grothcorp.com

Groth E-mail address:
sales@grothcorp.com



A Siegel-Robert Company



Pressure Equipment Directive
Available When Specified
CE-Marked Flame Arresters per
ATEX Directive Are Available
When Specified

GROTH CORPORATION

13650 N. Promenade Blvd.
Stafford, Texas 77477

Phone 281-295-6800 • Fax 281-295-6999
800-354-7684

CDC Corporate Headquarters

Continental Disc Corporation
3160 West Heartland Drive
Liberty, Missouri 64068-3385
Phone: + 816-792-1500
Fax: + 816-792-2277
E-mail: pressure@contdisc.com
Website: www.contdisc.com

Germany

Continental Disc
Deutschland GmbH
Virmondstrasse 151
47877 Willich Germany
Phone: + (49) 2156-490802
Fax: + (49) 2156-492547
E-mail: cdd@contdisc.com

The Netherlands

Continental Disc Corporation
Energieweg 20
2382 NJ Zoeterwoude-Rijndijk
The Netherlands
Phone: + (31) 71-5412221
Fax: + (31) 71-5414361
E-mail: cdcnl@contdisc.com

United Kingdom

Continental Disc UK Ltd.
Unit C, The Business Centre
Faringdon Avenue,
Harold Hill, Romford
Essex RM3 8EN
United Kingdom
Phone: + (44) 1708-386444
Fax: + (44) 1708-386486
E-mail: cduk@contdisc.com

China

Continental Disc Corporation
2026 The Executive Center
20/F The Center
989 Changle Rd.
Shanghai, 200031
P.R. China
Phone: + (86) 21-5117-5848
Fax: + (86) 21-5117-5849
Mobile: + (86) 137-8897-2291
E-mail: jyang@contdisc.com

Dubai

Continental Disc Corporation
P.O. Box 2234
Dubai, U.A.E.
Phone: + (971) 43214490
Fax: + (971) 43438840
Mobile: + (971) 508129525
E-mail: kannan@contdisc.com



1185 Tower Road
Schaumburg, IL 60173
Ph. 847.885.0300 Fax 847.885.0303
lindonequipment.com